



KW REQ. 30
 BHP REQ. 40

GEAR TRIM A
 TESTED AT 15 IN. HG.
 GRAY IRON CONSTRUCTION

25
 20
 15
 10
 5
 0

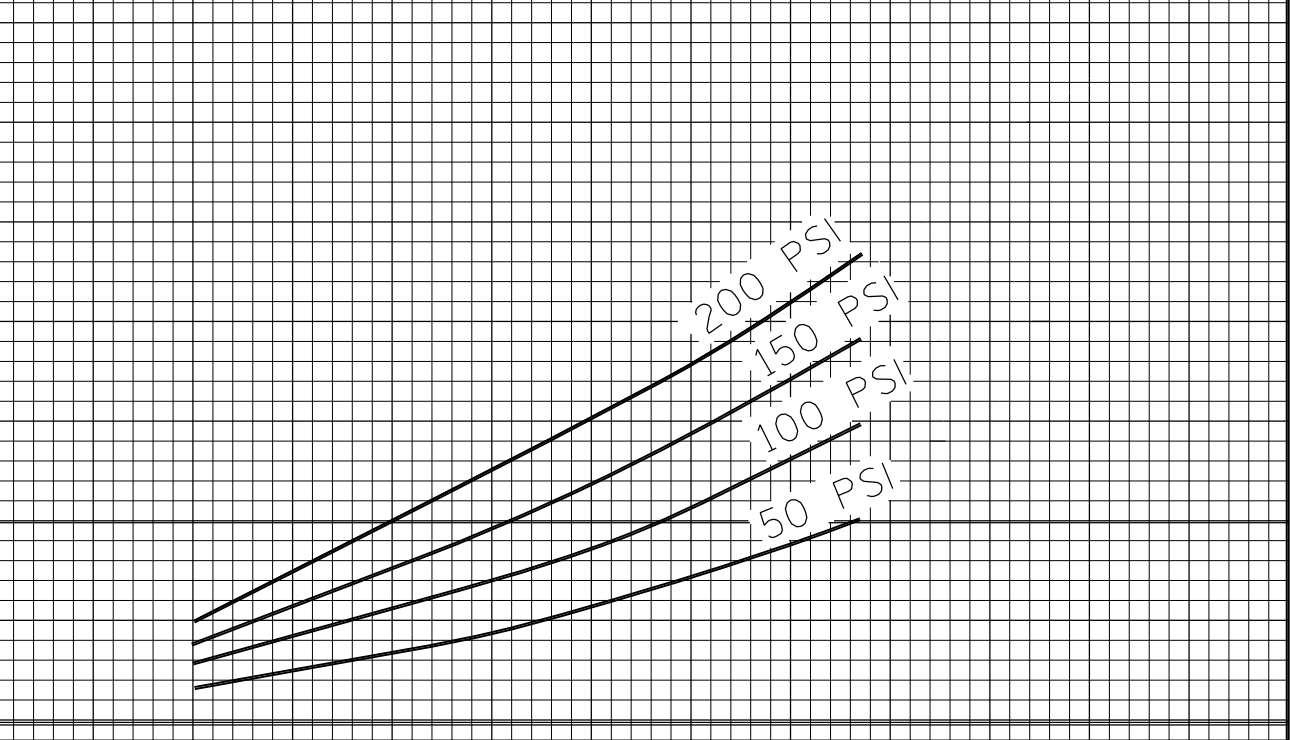

L/M GPM
 200
 70
 175
 60
 150
 50
 125
 40
 100
 30
 75
 20
 50
 10
 25
 0

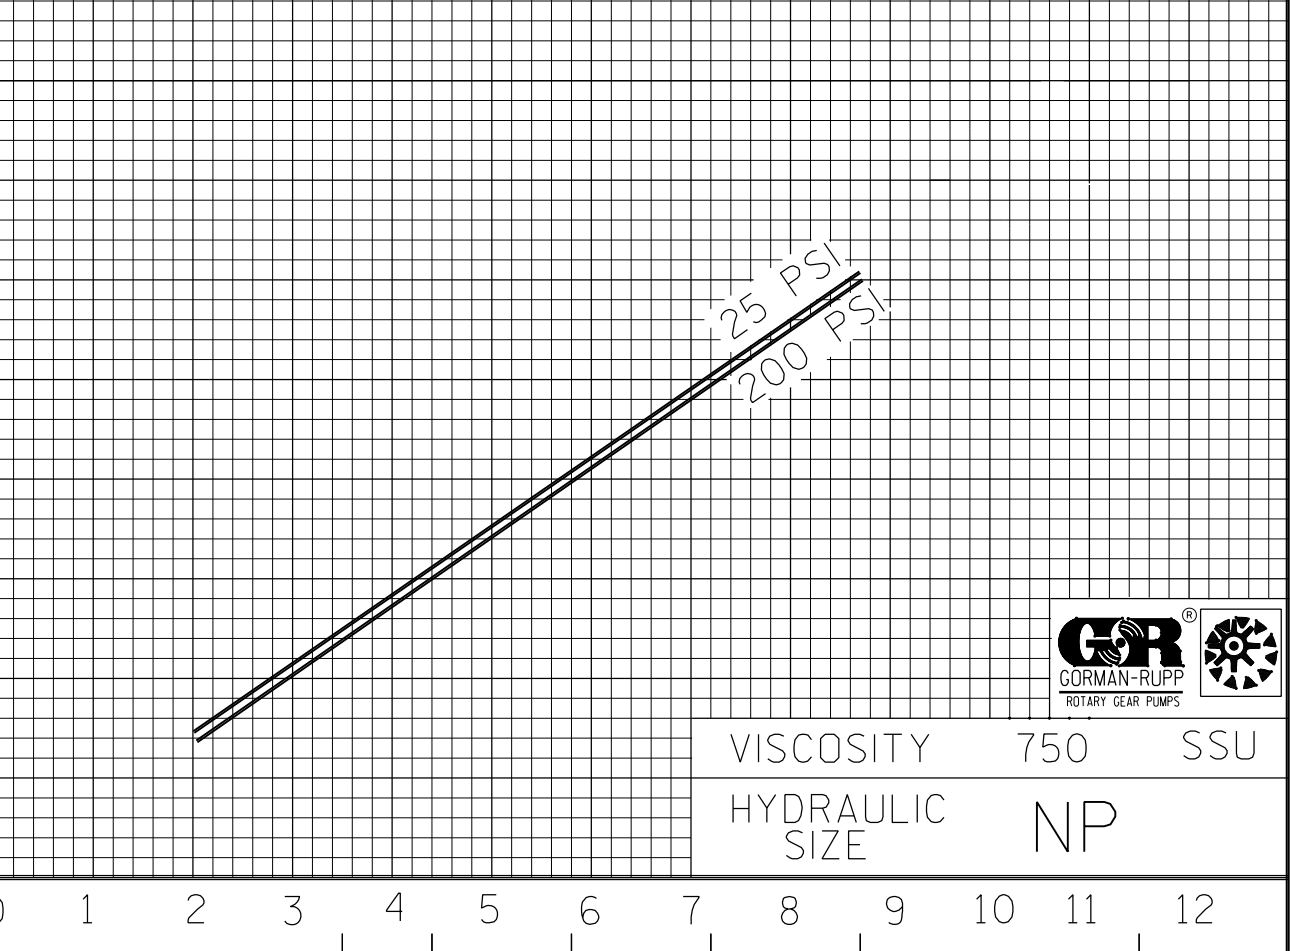

VISCOSITY 750 SSU

HYDRAULIC SIZE NP

DRIVE SPEED 350 440 580 720 870 1150

T-6-00-R PUMP SPEED-RPM NP-2

FILE NO. np.s02